

---

**From:** Doug Anders  
**Sent:** Monday, August 15, 2011 9:35 AM  
**To:** James Wall; Janna Orkney; Michael Paule (mikep969@gmail.com);  
mike\_mcreynolds@yahoo.com; sdiceland@aol.com  
**Cc:** Josie Guzman; Mark Lawler; Sandy Warren  
**Subject:** Triunfo Sanitation District - Sewer System Overflow 8/9/2011  
**Attachments:** Aspenwall\_Map\_Event ID 769681.jpg; Discharge Types.jpg

\*\*\*\*\* Sewer System Overflow \*\*\*\*\*

On Tuesday, August 9<sup>th</sup>, 2011 between the hours of 5:00 pm and 8:00 pm there was a sewer system overflow near 1603 Aspenwall Road, Westlake Village.

Approximately 60 gallons of raw sewage spilled through the pick hole of the manhole of the main sewer line. When staff arrived, the stoppage (or blockage) had cleared itself. Staff jetted the sewer line upstream and downstream of spill location. This spill is considered a "Category 1" spill (see attachment "Discharge Types") since the raw sewage entered a storm drain. In addition to cleaning the street, the storm drain was vacuumed. The Ventura County Environmental Health Division and Regional Water Quality Control Board were notified as required.


Staff is onsite doing additional investigation to determine the potential cause of the backup.

- Doug


Doug Anders  
Principal Analyst - VRSD  
(805) 658-4602

8/16/2011

Item 22-1



Map Photo Terrain

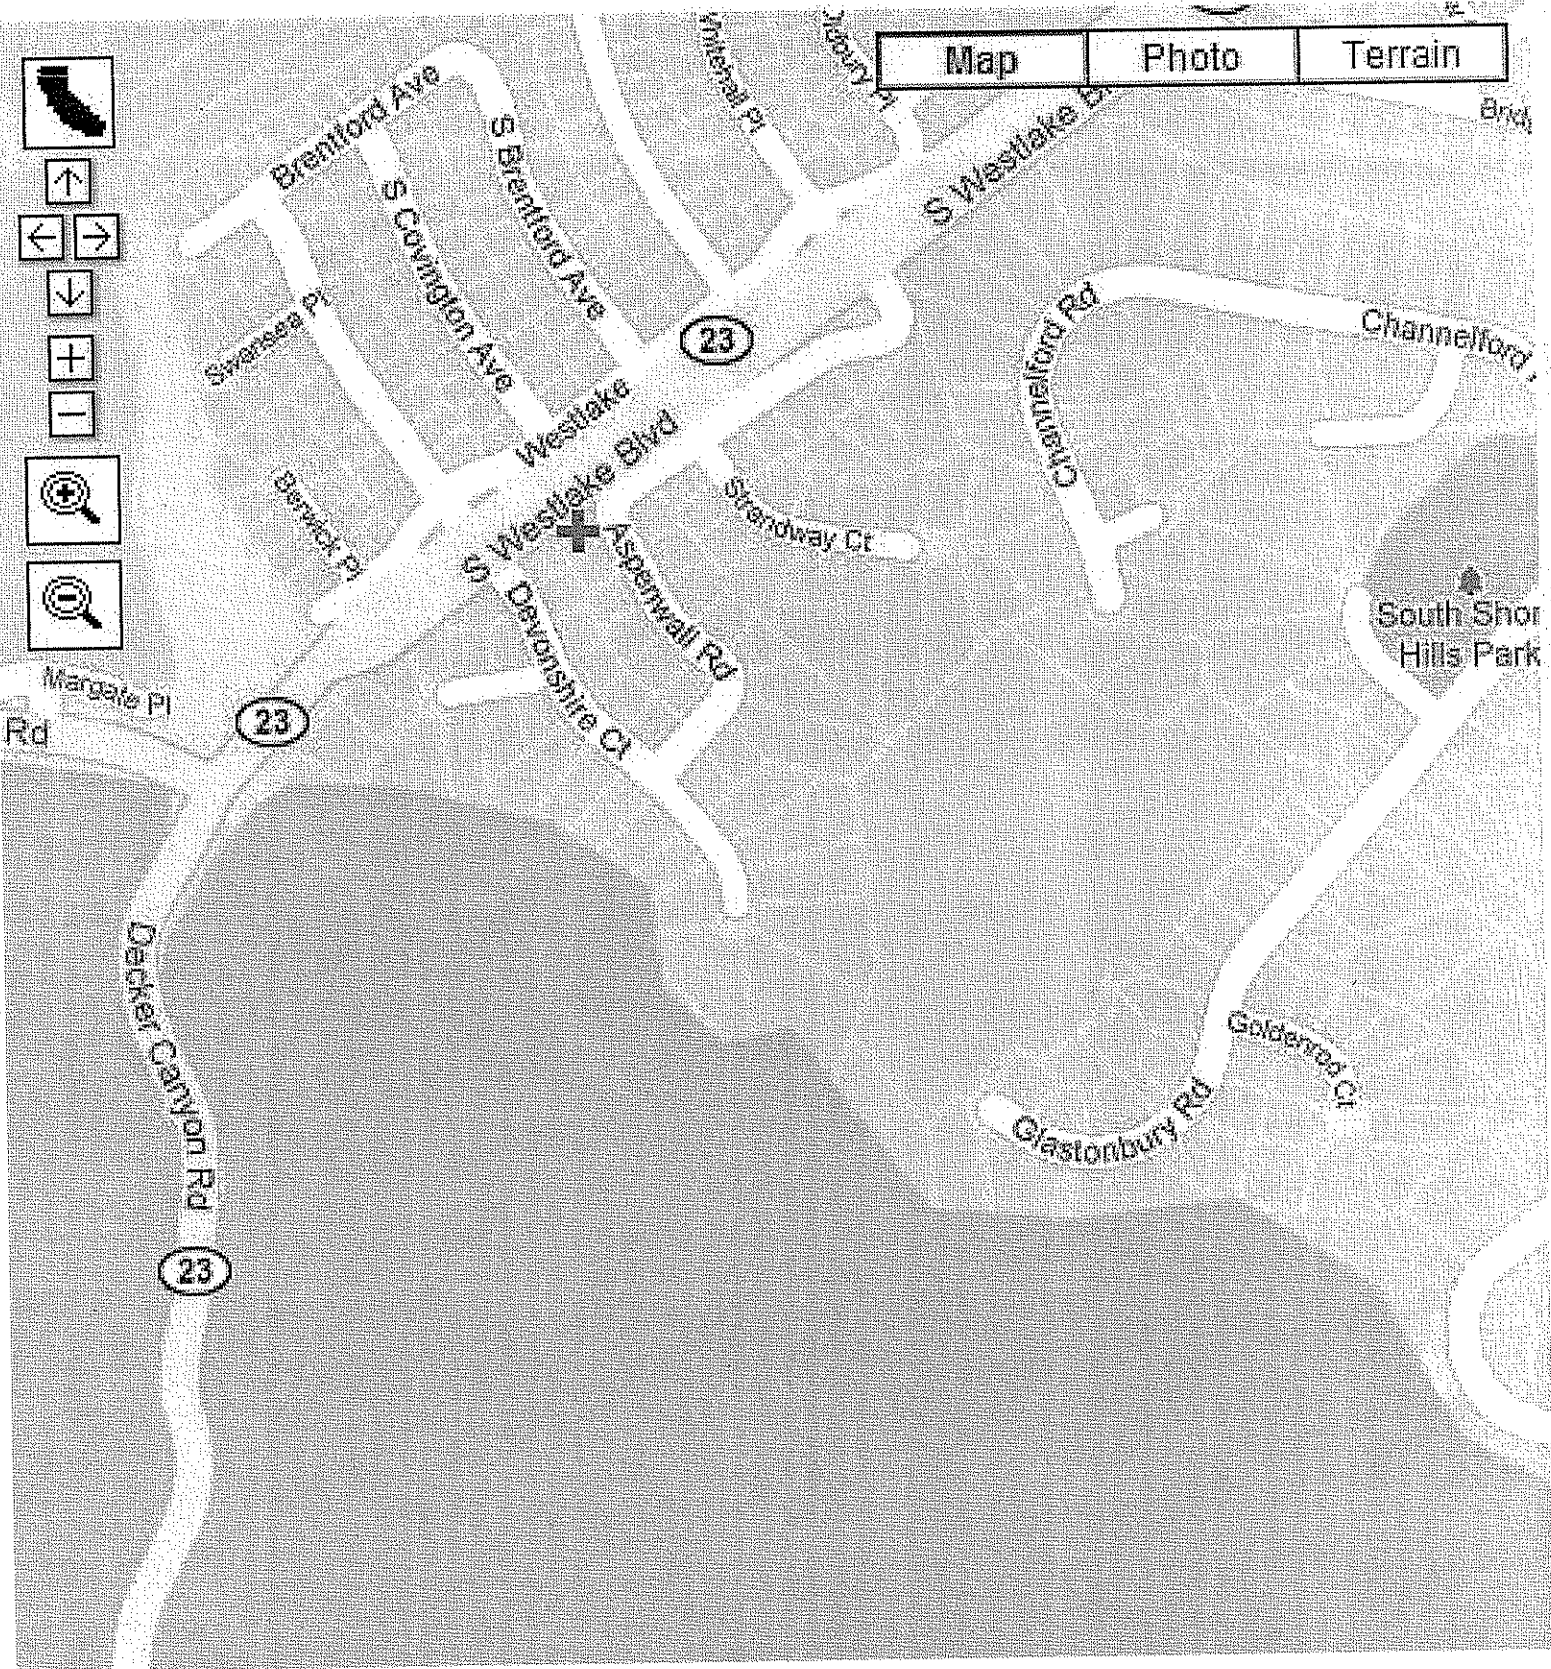

22-2

## Discharge Types

### Category 1

A discharge of sewage which (1) equals or exceeds 1000 gallons, or (2) a discharge of sewage to a surface water and/or drainage channel, or (3) a discharge of sewage to a storm drain that was not fully captured and returned to the sanitary sewer system. Category 1 spills represent a greater threat to public health.

### Category 2

Any discharge of sewage which does not meet the criteria for Category 1. Category 2 spills represent a lesser threat to public health.